
Vickers®

Pressure Relief

Pressure Reducing Valves


XGL-03-B-10 XSL-03-B-10 XTL-03-B-10



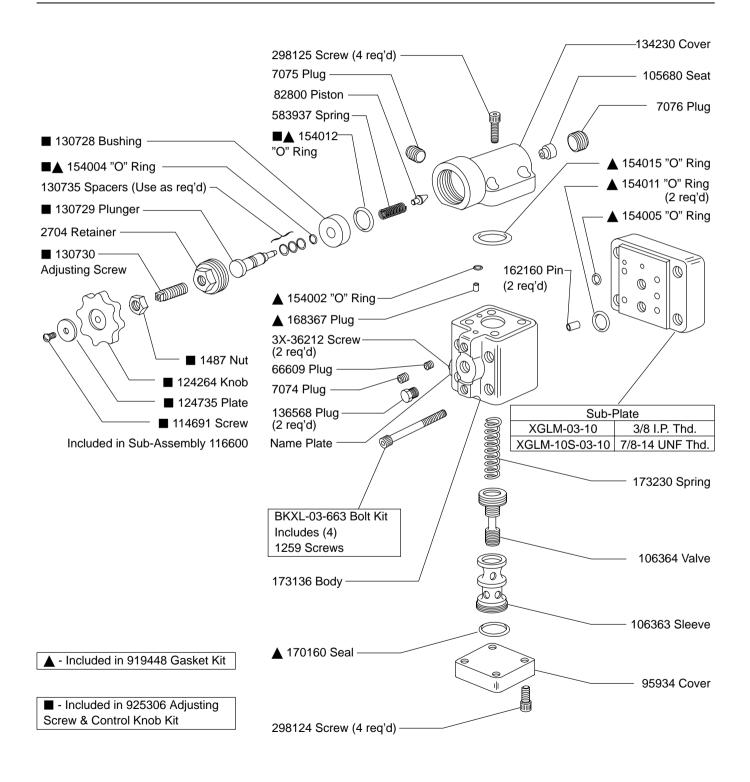



Revised 11/01/85 I-3350-S

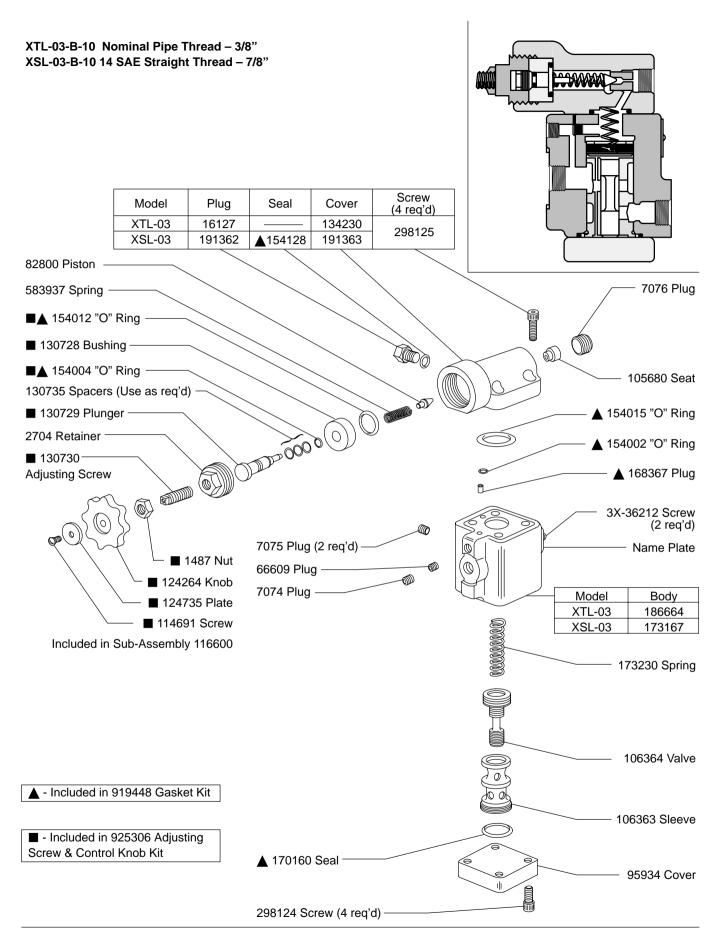

For satisfactory service life of these components, use full flow filtration to provide fluid which meets ISO cleanliness code 18/15 or cleaner. Selections from Eaton OFP,OFR and OFRS filter series are recommended.